


# ESTEVAN AREA TRANSMISSION LINES

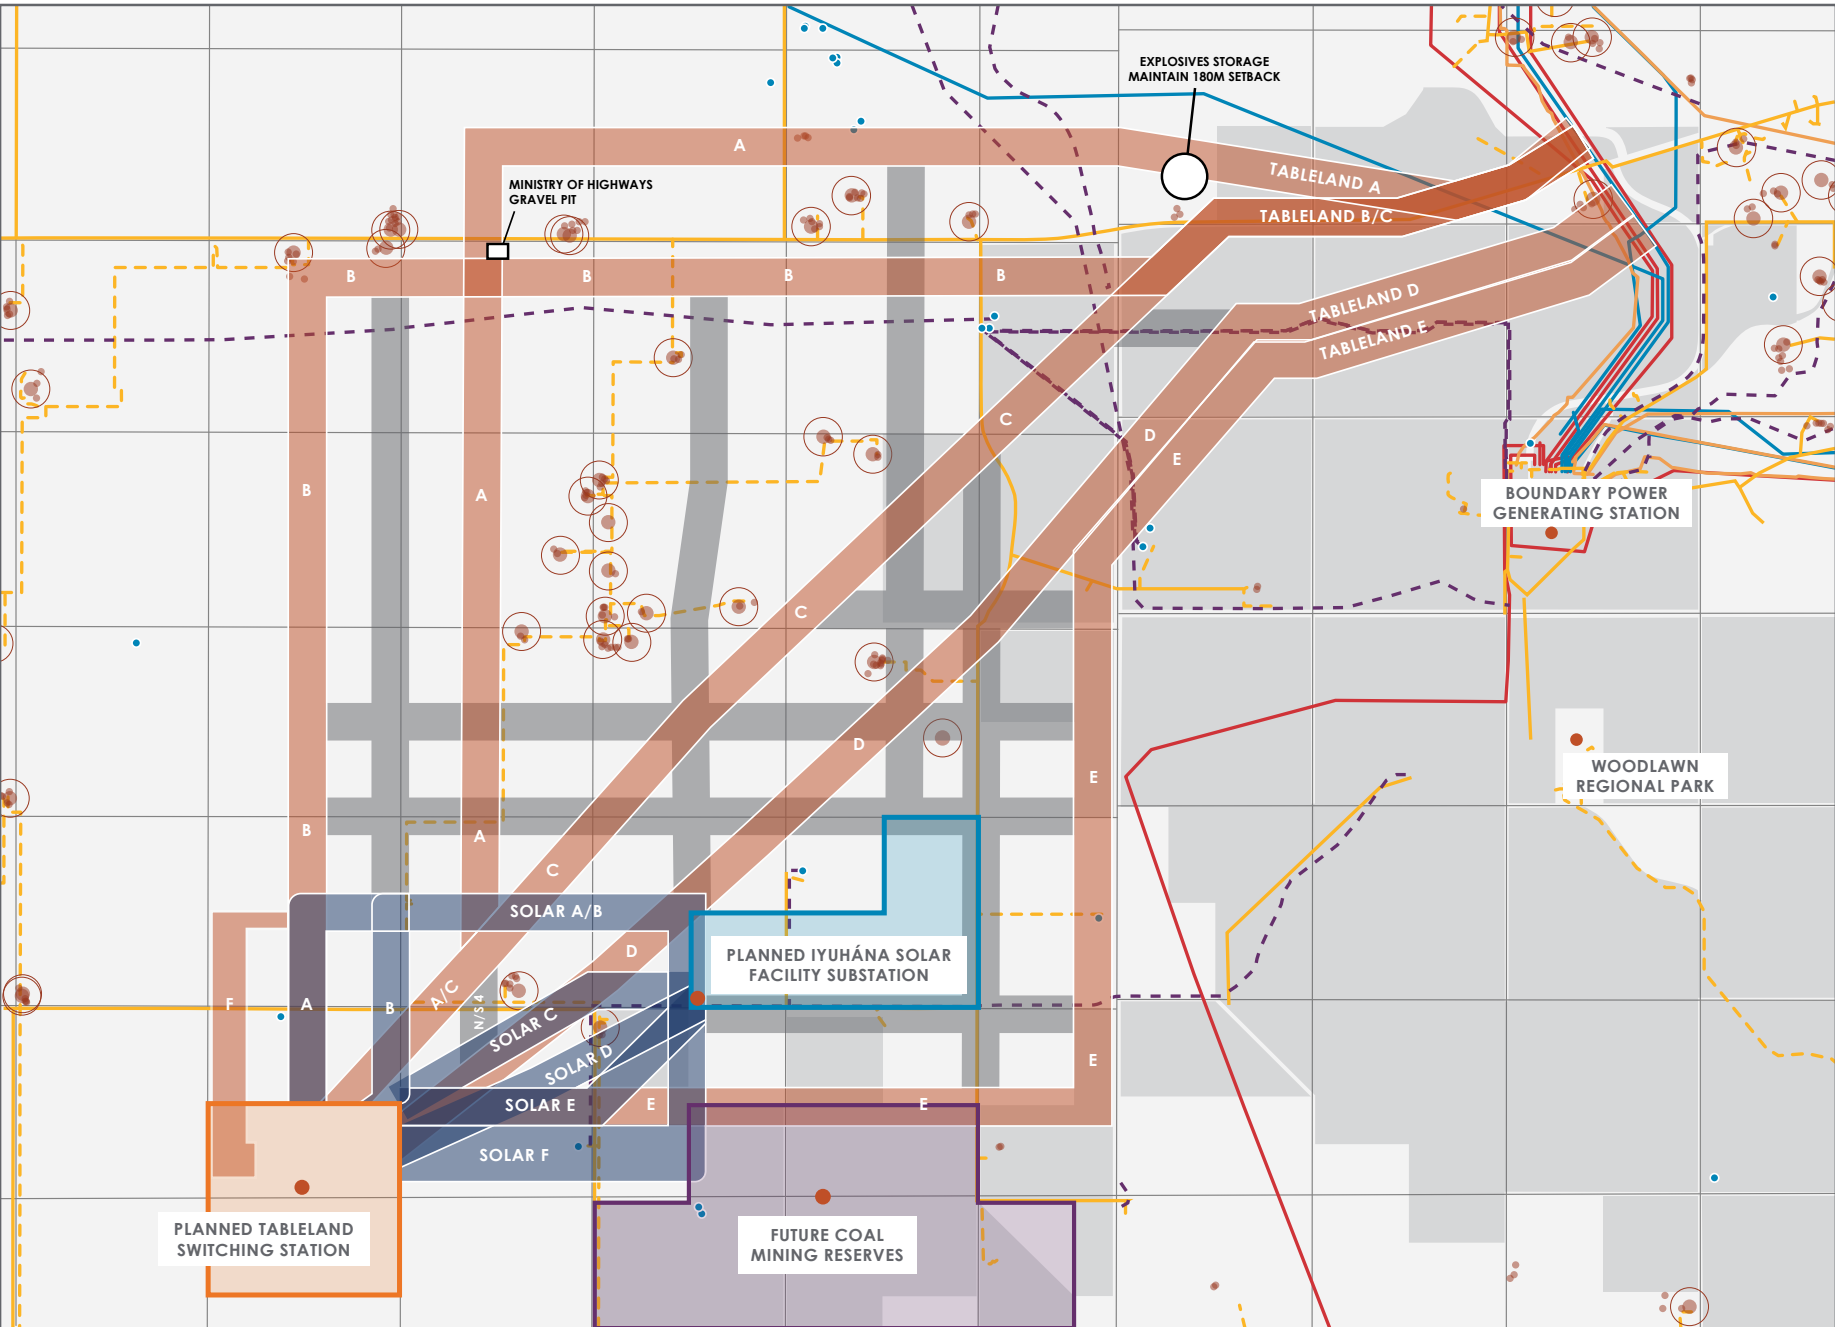

## Transmission Routes

- Tableland Station Potential Route Alternatives
- Iyuhána Solar Facility Potential Route Alternatives
- Potential Cross-over Corridors
- SaskPower-owned Land

## Rural Residences and Other Buildings

- 160 m Prudent Avoidance Buffer
- 60 m Minimum Avoidance Buffer (rural residences)
- 30 m Minimum Avoidance Buffer (non-residential buildings)

## Existing Infrastructure

- 230kV Transmission
- 138kV Transmission
- 72kV Transmission
- Overhead Distribution Line
- Buried Distribution Line
- Buried Pipeline
- Oil & Gas Wells