
SOUTHERN SPRINGS SOLAR INTERCONNECTION

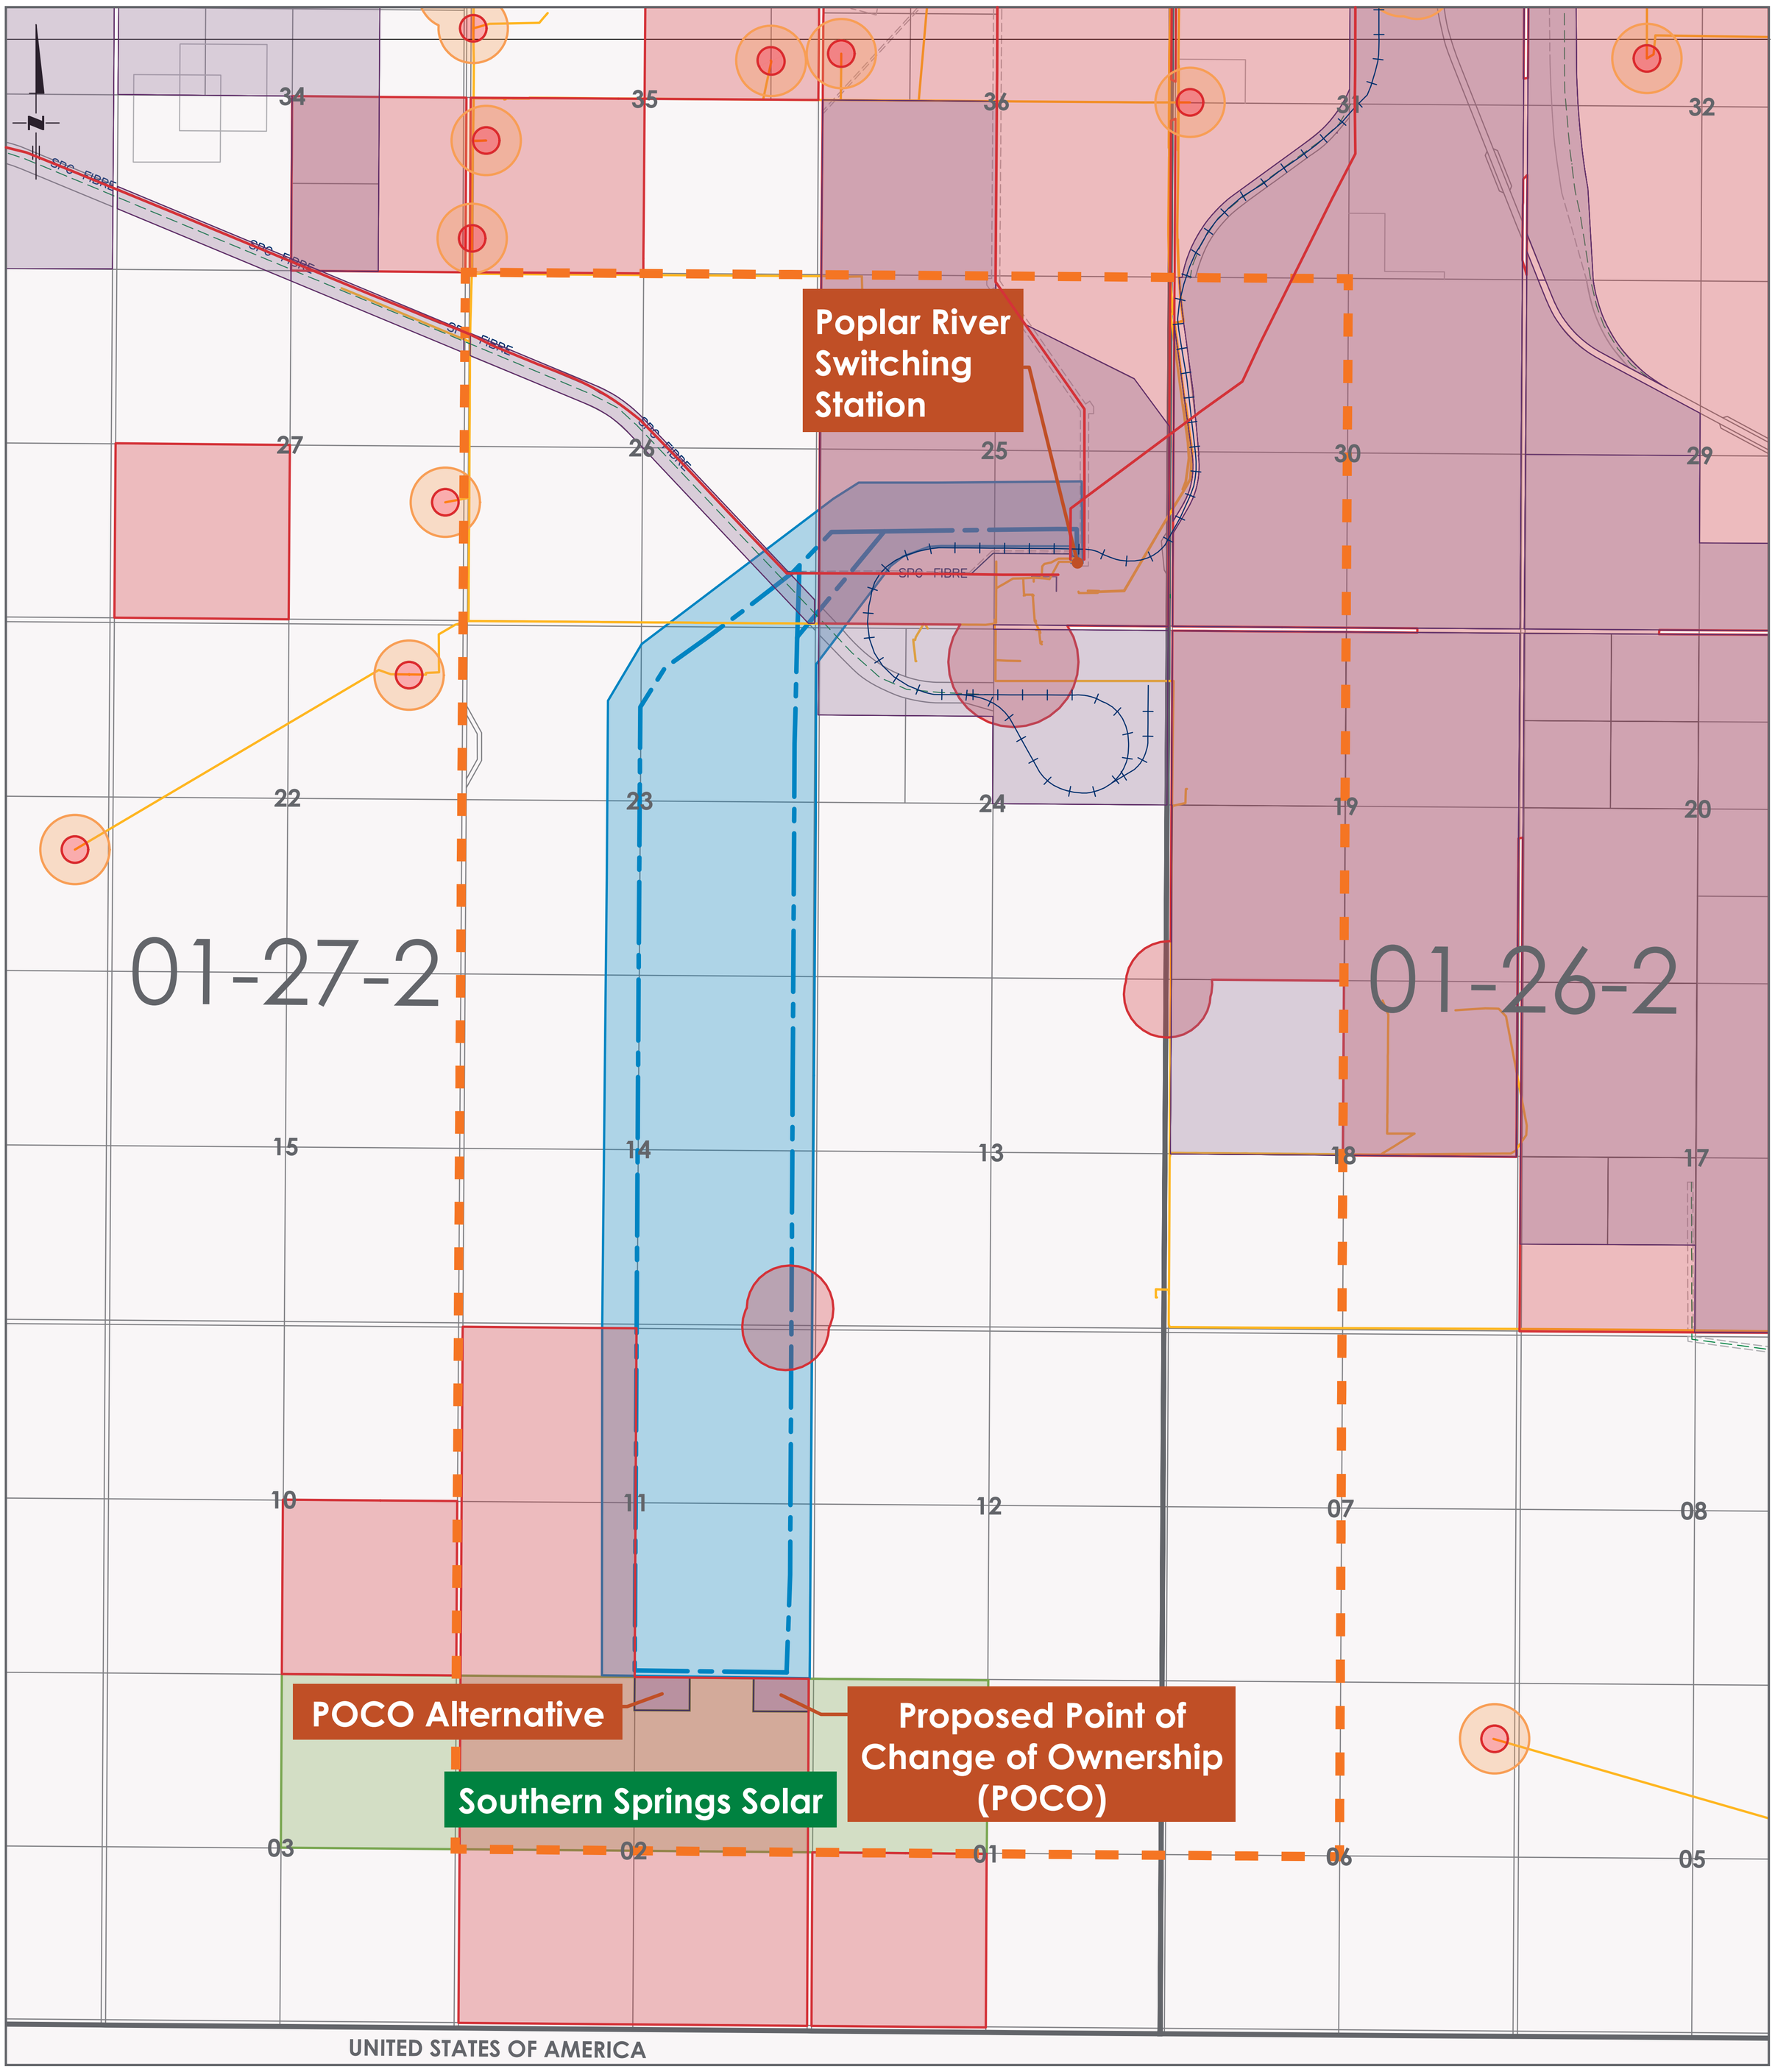

SaskPower

- Study Area
- Proposed Transmission Corridor
- Proposed Route
- Existing SaskPower Land
- Southern Springs Solar
- Proposed Point of Change of Ownership (POCO)

Existing Infrastructure

- 230kV Transmission Line
- 138kV Transmission Line
- Fibre Optic Line
- Overhead and Underground Distribution Lines
- Pipeline

Topology

- Railway

Constraints

- House Buffer
 - Red denotes 61m minimum clearance
 - Orange denotes 160m avoidance buffer
- Environmental Contraints

SaskPower
Powering our future®